


↑
AIR OUTLET


TOP DISCHARGE AREA SHOULD BE UNRESTRICTED
FOR 100 INCHES MINIMUM. UNIT SHOULD BE
PLACED SO ROOF RUN-OFF WATER DOES
NOT POUR DIRECTLY ON UNIT.

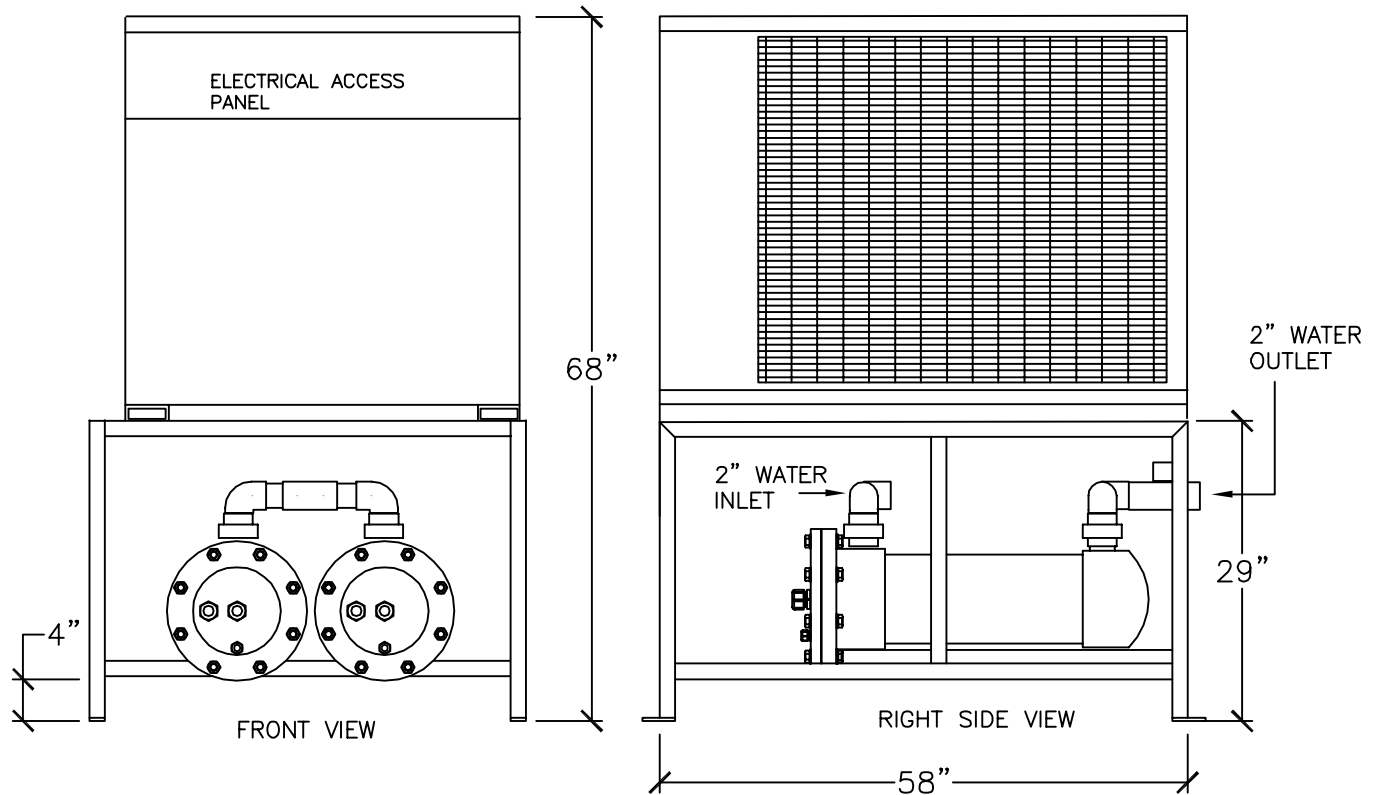

MINIMUM CLEARANCE FOR PROPER OPERATION IS
36 INCHES FROM THE WALLS, SHRUBBERY, FENCES,
ETC. MINIMUM CLEARANCE BETWEEN ADJACENT
UNITS IS 72 INCHES.

SPECIFICATIONS:

MODEL NO: _____ MT-10-460
 HP: _____ 10
 VOLTS / PH / Hz _____ 460 / 3 / 60
 VOLTAGE MIN-MAX _____ 414-506
 TOTAL UNIT AMPS _____ 20 RLA / 124 LRA
 MIN. CIRCUIT AMP. _____ 24
 MAX. FUSE _____ 35
 MAX. BTUH OUTPUT _____ 120,000
 MIN - MAX WATER FLOW _____ 60 / 120 GPM
 WEIGHT _____ 700 LBS
 REFRIGERANT TYPE _____ R-22
 FAN AIR OUTPUT _____ 8200 CFM
 HX CONSTRUCTION _____ TITANIUM TUBE IN PVC SHELL

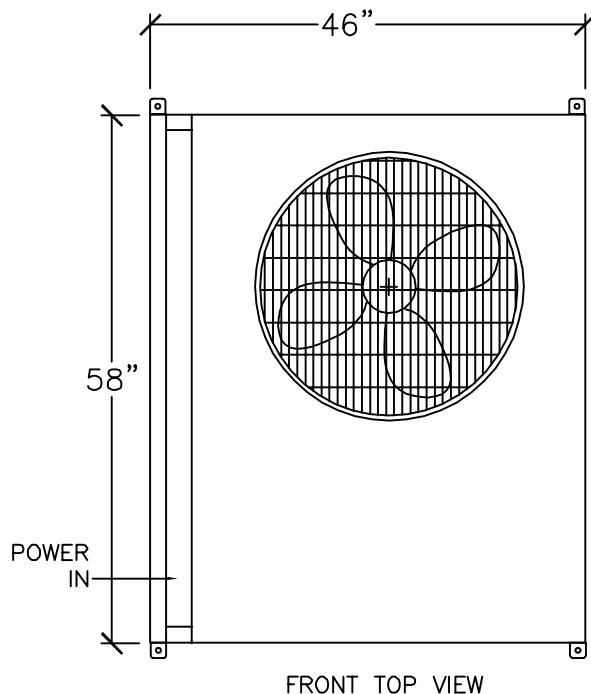

Aqua Logic, Inc.
 8268 Clairemont Mesa Blvd. Suite 302
 San Diego, CA 92111

TITLE: MT-10 460V 3PH
 CHILLER

LAST
 UPDATE: 5-1-06

DATE: 7-16-04

FILE:
 MT-10-460 10hp 460v3 Trane

BY CE